

Island County Water Well Information



WellKey: DRG

General Information

Owner Name (log): Joe Roberts

DOE Tag: ALS428

DOE NOI: [W167096](#)

DOE ID

[504816](#)

Well Address: 1005 SE Camano Dr


Well Parcel:

Served Parcel:

Horiz/Vert Accuracy: Site Plan / Survey

Site Type: Well

SWI Rating: Low Risk

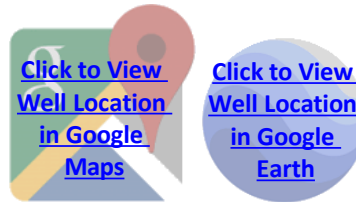

Construction Information

Construction Date: 10/15/07

Driller Name: Camano Well Drilling


LS Elevation: 99.45 ft. MSL

Depth Well: 194 ft.

TD Elevation: -95 ft. MSL

WL Measurements: [1 measurement \(Click to View\)](#)

WL Elevation: 14.44 ft. MSL

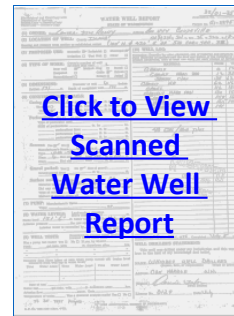

Water Quality Information

Water Samples: [2 samples \(Click to View\)](#)


Avg/Med/Max Arsenic: 0.002 / 0.002 / 0.002 mg/l

Avg/Med/Max Chloride: 10.00 / 10 / 10 mg/l

Avg/Med/Max Hardness: 109.00 / 109 / 109 mg/l

Avg/Med/Max Nitrate: 0.10 / 0.1 / 0.1 mg/l

Bacteria Samps (distribution): [4 samples \(Click to View\)](#)

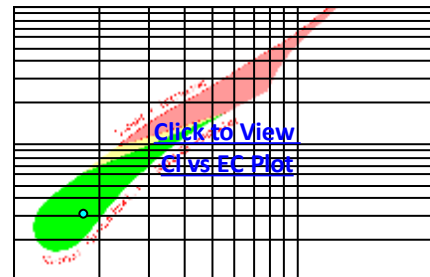

Public Water System Information


Pws Name: Cav-1 Water System

PwsID: [AC418](#)

Approved Connects: 5

Pws Source #: SO# 1

Pws Source Name: Well ALS428

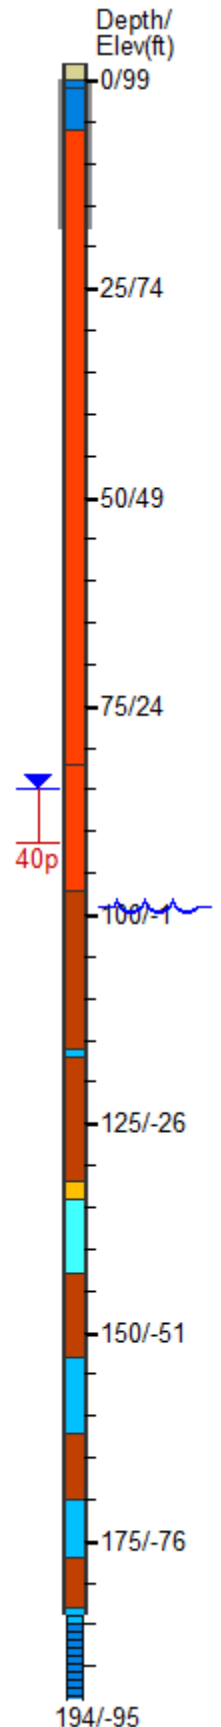

Note: Underlined items in **bright blue** are hyperlinks to additional information / resources.
Questions? Contact the [Island County Hydrogeologist](#), or visit the [Hydrogeology Web Page](#).

Report Generated: 12/31/2020